


The 2-way cleanout may be located anywhere on private property from the structure to the property line.

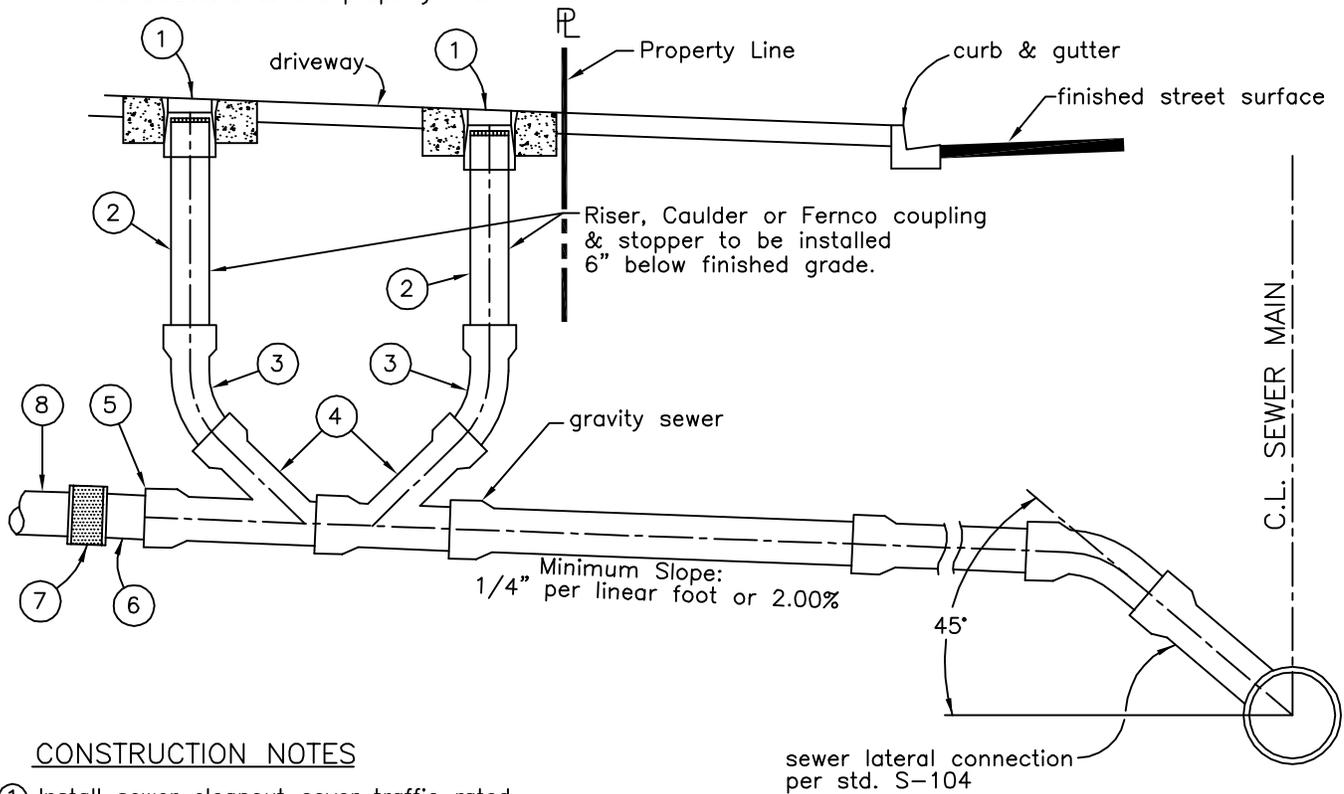


CONSTRUCTION NOTES

- ① Install sewer cleanout cover traffic rated.
- ② 4" (or 6") SDR-35 PVC sewer pipe with gasketed, integral bell and spigot joints.
- ③ 4" (or 6") SDR-35 PVC 45° bend.
- ④ 4" x 4" (or 6"x 6") SDR-35 PVC wye branch fitting.
- ⑤ 4" (or 6") ABS stopper (where laterals are stubbed)
- ⑥ 4" (or 6") short piece, SDR-35 PVC, 6-inches long.
- ⑦ 4" (or 6") rubber mechanical banded seal clamp. Fernco or approved equal.
- ⑧ 4" (or 6") private sewer lateral.

GENERAL NOTES

- 1. Minimum slope for 4" or 6" sewer lateral shall be 1/4" per foot unless authorized.
- 2. Sewer cleanout shall include a stopper over risers. Use Mission Clay products stopper or equal.
- 3. Sewer cleanout riser pipe material shall be 4" or 6" VCP, ABS, SDR-35.
- 4. A cleanout shall be installed on all sewer lateral connections.
- 5. PVC shall be SDR-35 per ASTM 3034.
- 6. PVC pipe and fittings shall be bedded with 3/4" aggregate base rock material.
- 7. Where VCP materials are used, bedding shall be 3/4" aggregate base rock material.
- 8. Two riser pipes are required for a 2-way clean out. A 2-way cleanout with one riser pipe is not allowed.

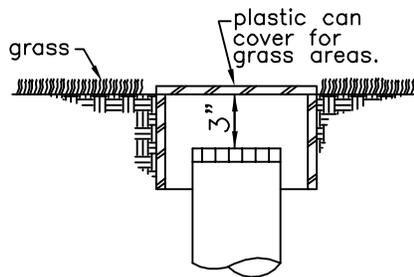

DETAIL-UNPAVED AREA

COSTA MESA SANITARY DISTRICT

Date: 04/25/13

**2 WAY CLEAN OUT
ON PRIVATE PROPERTY**

Approved: *AH*

District Engineer -R.C.E. 31720

Drawing N^o S-107-A